



9990

Intumescent Door Cap System

INSTALLATION INSTRUCTION

For the complete list of GapGuard Fire Door Accessories, the most up-to-date product information and installation instructions, scan the QR code or visit ngp.com.



UL Certified for use on up to 180 minute UL10B and UL10C wood or hollow metal fire doors with clearance at head exceeding $\frac{1}{8}$ " 9990: up to $\frac{1}{2}$ ".


Installation Instructions

L-Shaped Cap with Intumescent (Push Side Mount):

1. Cut to fit.
2. Prep for top latching hardware (ie: Concealed Vertical Rod Exit Device latch or strike plate or Automatic Flush Bolt) that is installed in accordance with manufacturer's installation instructions and around any fire labels to keep from obstruction.
3. Close door. Hold at top of door with $\frac{1}{8}$ " clearance to frame header.
4. Mark screw holes.
5. Drill pilot holes for screws using a $\frac{7}{64}$ " drill bit.
6. Install with screws provided.
7. Adjust position for $\frac{1}{8}$ " clearance to frame header.

Straight Cap (Pull Side Mount):

1. Cut to fit.
2. Close door. Hold at top of door. Align top edge with top of L shaped cap.
3. Mark screw holes.
4. Drill pilot holes for screws using a $\frac{7}{64}$ " drill bit.
5. Install with screws provided.
6. Adjust to proper position.
7. Install end caps if desired - as illustrated.

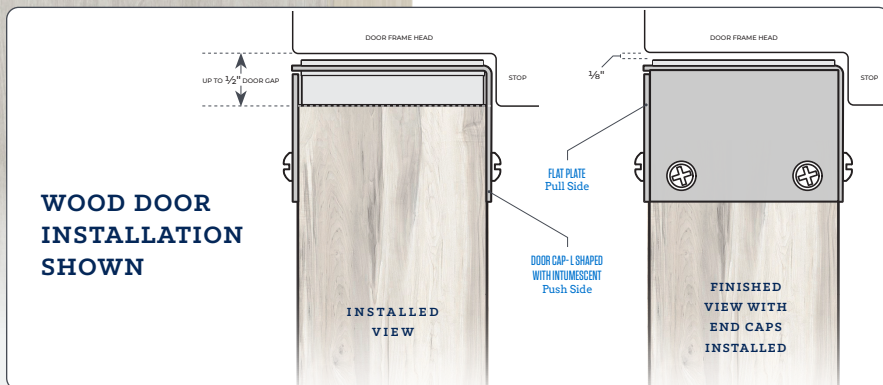

POSITIVE PRESSURE TESTED
MISCELLANEOUS FIRE DOOR
ACCESSORY

5.26

NGP-GAP-9990-PRI-0526-A



MEMPHIS | CARSON CITY

NATIONAL GUARD PRODUCTS, INC.

MEMPHIS

4985 East Raines Road
Memphis, TN 38118
orders@ngp.com

CARSON CITY

3689 Arrowhead Drive
Carson City, NV 89706
carsonorders@ngp.com

Fax: (800) 255-7874
Email: info@ngp.com
Quotes: quotes@ngp.com

ngp.com
1-800-NGP-RUSH