


GAP90

FIRE DOOR HEAD AND JAMB GAP SOLUTION



UL CERTIFIED FOR USE IN
THE US AND CANADA

- UL Certified Solution for Hollow Metal Fire Doors Rated up to 180 Minutes, and Wood Fire Doors Rated up to 90 Minutes with Excessive Clearance Between Door and Frame Over $\frac{1}{8}$ " up to $\frac{9}{16}$ "

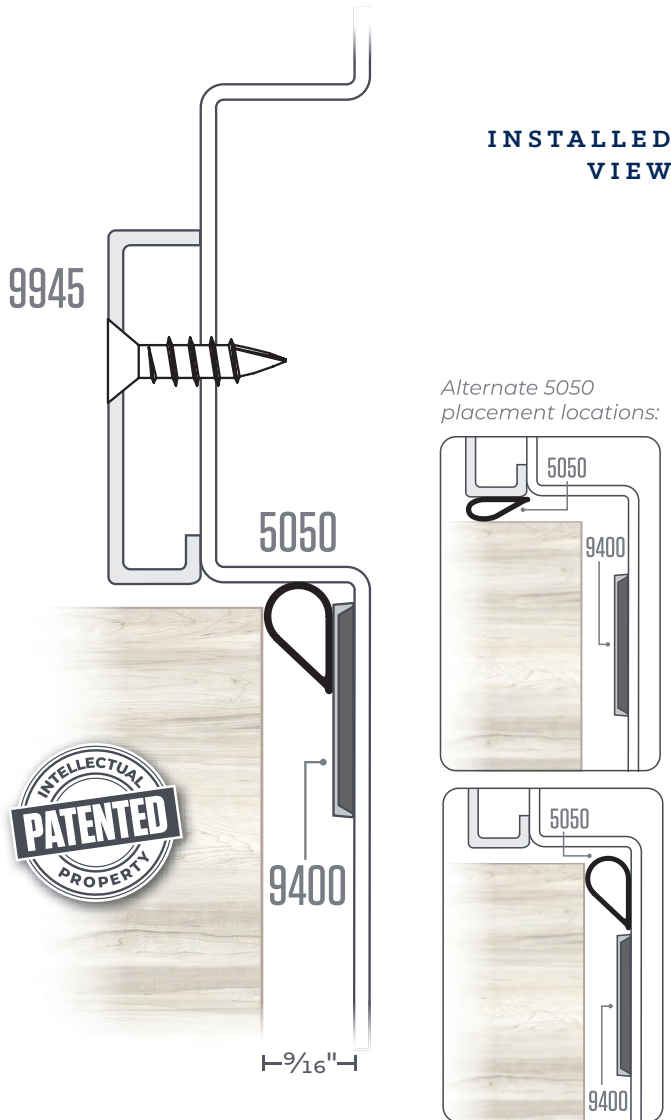

INSTALLED
VIEW

Alternate 5050
placement locations:




PRODUCT CONSISTS OF:

9945


Steel Stop Extender

- 16-Gauge, Gray Primer Finish
- Furnished with #10 X 1" TEK SMS
- Embossed with **UL Mark**
- Patented: US Patent 9,273,510 B2

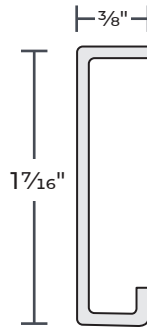

5050

Silicone Bulb Fire and
Smoke Seal



5050C CHARCOAL



9400

NGP-Edge® Intumescent
Seal with PVC Cover



9400GR GRAY

9400C CHARCOAL



POSITIVE PRESSURE TESTED
MISCELLANEOUS FIRE DOOR
ACCESSORY

180-Minute Rated UL Certified Miscellaneous Fire Door Accessory on UL10B and UL10C Wood or Hollow Metal Fire Doors.

Multiple Strike Shims 9275 or 9225 may also be Required for Proper Latchbolt Engagement.

Doors with Parallel Arm Closers — Use 9990 Fire Door Top Gap Solution.

GAP90 INCLUDES 9945, 9400GR, 5050C

GAP90DKB INCLUDES 9945, 9400C, 5050C

Available in 36", 48", 84" and 96" Lengths